


NOTE:

WALK TO BE DIVIDED INTO EQUALLY SPACED BLOCKS AT APPROXIMATELY 5' INTERVALS. WHERE MH CASTINGS ARE ENCOUNTERED THE CONSTRUCTION JOINT SHALL BE PLACED SO THAT IT BISECTS THE CASTING. EXPANSION JOINT FILLER $\frac{1}{2}$ " THICK FULL DEPTH OF SLAB SHALL BE INSTALLED EVERY 25' AND BETWEEN WALK AND ANY FIXED STRUCTURE EXTENDING FOR THE FULL DEPTH OF THE SIDEWALK, DRIVEWAYS, EXISTING CONCRETE AND MASONRY STRUCTURES. THE EXPANSION JOINT FILLER SHALL BE $\frac{1}{2}$ " THICK FULL DEPTH OF SLAB WHERE WALK IS INSTALLED AGAINST BACK OF CURB. SIDEWALK TO BE 6" THICK WITHIN DRIVEWAY LIMITS.

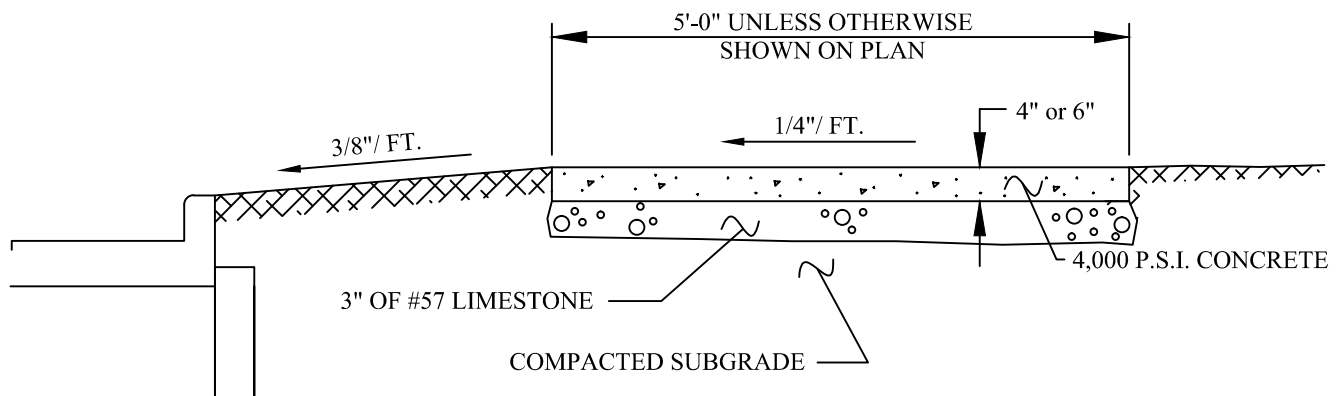

CITY OF SOLON ENGINEERING DEPARTMENT	STANDARD DETAIL	TYPICAL SIDEWALK
		S-1